

Powertek

Data Sheet

PTK CON M+

Programmable Multi-function Transducer



Measure



Control



Record



Analyze



Optimize

Overview

PTK CON M+ transducer is used to measure and convert parameters of a single-phase or three-phase AC system with unbalanced or balanced load into a proportional load independent DC current or DC voltage output signal. It also provide digital output which can be configured for energy pulse output or limit output or timer output.

Product Features

4-in-1 programmable transducers

Measurement parameters like voltage, current, power, frequency and many more can be configured to any analog or digital output.

Voltage or current, Linear or Bent characteristic configurable upto 4 isolated analog outputs.

Digital output configurable to Pulse output, Limit output or timer output.

Measuring Input

AC Voltage/Current input signal, sine wave or distorted wave form upto 31st Harmonics.

Measurement of instantaneous values of more than 50 quantities (Voltage, Current, Power (W, VAR, VA), Power Factor, Phase Angle, Frequency, System and Per Phase Demand, THD, System and Per Phase Energy (Wh, VARh, Vah)

Fast Response Time

Analog Output response time is less than 300 msec.

Best In Class Accuracy

Transducer Class 0.2 Accuracy as per IEC 60688.

Active Energy Class 0.5s as per IEC 62053-22.

USB Communication

Transducer can be configured onsite using USB.

USB is self-powered so device configuration is possible, both with and without auxiliary supply.

RS485 Communication Interface

Optional MODBUS RS485 interface for monitoring and configuration purpose is also provided.

Programmable Input/Output

Transducer Input and Outputs can be programmed on-site using USB or RS485 Interface.

Compliance to International Safety standards

Compliance to International Safety standard

IEC 61010-1-2010

EMC Compatibility

Compliance to International standard IEC 61326.

Fast and easy installation on DIN RAIL and Wall Mount

Connection Terminal: Conventional Screw type

Symbols and their meaning

X = Input Parameter

Voltage, Current, Powers, Power Factor,
Phase angle, Frequency and many more.

X0 = Start value of input

X1 = Elbow value of input

X2 = End value of input

Y = Output DC Voltage / DC Current

Y0 = Start value of output DC Voltage / DC Current

Y1 = Elbow value of output DC Voltage / DC Current

Y2 = End value of output DC Voltage / DC Current

R_N = Rated value of output burden

F_N = Nominal Frequency



Measure



Control



Record



Analyze



Optimize

Dimensions Details:



Fig. 1 PTK CON M+ Dimensions

Technical Specifications:

Measured Parameter

Please refer Table 1 for List of measured parameters

Network Type Supported by transducer:

Single Phase/ 3 phase 3 wire Unbalanced/ 3 phase 4 wire Unbalanced/
(U12 I1) 3 Phase Balanced/ (U23 I1) 3 Phase Balanced/ (U31 I1) 3 Phase Balanced/
3 Phase 3 wire Balanced/ 3 Phase 4 wire Balanced

Nominal Voltage Input (U_N)

Nominal input Voltage (AC RMS) (PT Secondary range)	$100 \text{ V} \leq U_N \leq 600 \text{ VL-L}$
PT Primary range	100V to 1200 KVL-L
Nominal Frequency F_N	40 Hz to 70 Hz
Nominal input Voltage burden	$< 0.3 \text{ VA}$ per phase at U_N
Overload Capacity	$1.5 * U_N$ continuously, $2 * U_N$ for 1 second, repeated 10 times at 10 seconds intervals

Nominal Current Input (I_N)

Nominal input Current (AC RMS) (CT Secondary range)	$1 \text{ A} \leq I_N \leq 5 \text{ A}$
CT Primary range	1 A to 9999 A
Nominal Frequency F_N	40 Hz to 70 Hz
Nominal input Current burden	$< 0.3 \text{ VA}$ per phase at I_N
Overload Capacity	$2 * I_N$ continuously, $20 * I_N$ for 1 second, repeated 5 times at 5 seconds intervals

Allowed measuring range end values X2 (calibration factor Xc)

Current Input	$0.50 < (X2/\text{Rated Value}) < 2.0$
Voltage Input	$0.60 < (X2/\text{Rated Value}) < 1.5$
Power Input	$0.30 < (X2/\text{Rated Value}) < 1.5$
Frequency Input	$40 \text{ Hz} < X2 < 70 \text{ Hz}$
Power Factor	$0 < X2 < 1$
Phase Angle	$0 < X2 < 175 \text{ Deg}$

Rated value is the nominal value of selected input parameter as per Network type.

Measuring Output Y(For 4 Analog Outputs)

Output type	Load independent DC Voltage , DC Current On site selectable through USB or RS-485 Interface.
Load independent DC output	Unipolar 0...20mA / 4...20mA OR 0...10V. Bipolar -20mA...0...+20mA OR -10V...0...+10V
Output burden with DC current output signal	$0 \leq R \leq 15 \text{ V/Y2}$
Output burden with DC voltage output signal	$Y2/(2 \text{ mA}) \leq R \leq \infty$
Current limit under overload $R=0$	$\leq 1.25 * Y2$ with current output $\leq 100 \text{ mA}$ with voltage output
Voltage limit under $R=\infty$	$\leq 1.25 * Y2$ with voltage output $\leq 30 \text{ V}$ with current output
Residual Ripple in Output signal	$\leq 0.4\% \text{ pk-pk}$
Response Time	$\leq 300 \text{ ms}$



Measure



Control



Record




Analyze




Optimize

Output Characteristics

Example of setting with Linear Characteristics

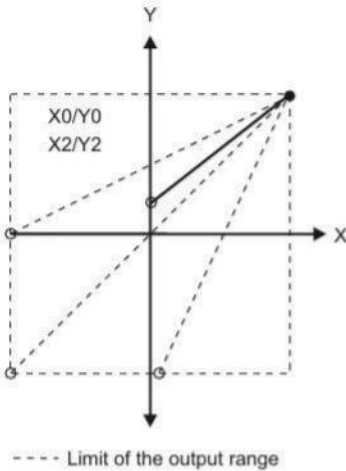

Example of setting with bent Characteristics

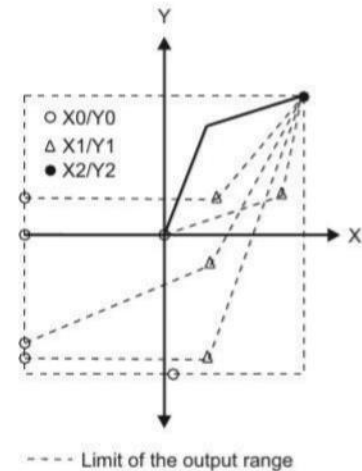

X0 = Start value of input

Y0 = Start value of output

X1 = Elbow value of input

Y1 = Elbow value of output

X2 = End value of input

Y2 = End value of output

Technical Specifications:

Auxiliary Power Supply

AC/DC Auxiliary Supply	85V... 285 VAC-DC (240V Nominal Value)
AC Auxiliary supply frequency range	45 to 65 Hz
Auxiliary supply consumption	< 10VA

Accuracy of Analog Output as per Selected input Parameter (Acc. to IEC / EN 60688)

Reference Value	Output end Value Y2 (Voltage or Current)
Voltage	± 0.2C
Current	± 0.2C
Frequency	± 0.2C
Power Factor / Phase Angle	± 0.5C
Active Power	± 0.2C
Reactive Power	± 0.5C
Apparent Power	± 0.2C

Factor C (The highest value applies if calculated C is less than 1, then C=1 applies)

Linear characteristics

$$C = \frac{Y2-Y0}{X2-X0} \times \frac{X2}{Y2} \text{ or } C=1$$

Bent characteristics

$$\text{For } X0 \leq X \leq X1 \quad C = \frac{Y1-Y0}{X1-X0} \times \frac{X2}{Y2} \text{ or } C=1$$

$$\text{For } X1 \leq X \leq X2 \quad C = \frac{Y2-Y1}{X2-X1} \times \frac{X2}{Y2} \text{ or } C=1$$

Reference conditions for Accuracy

Ambient temperature	23°C +/- 1°C
Pre-conditioning	30 min acc. to IEC / EN 60688
Input Variable	Voltage Rated / Current Rated
Input waveform	Sinusoidal, Distortion factor 0.005
Input signal frequency	50 or 60Hz
Active / Reactive factor	Cos Φ=1 / Sin Φ = 1 resp.
For Phase Angle & Power Factor Transducer	Reference Value For Phase angle = 90°
Auxiliary supply voltage	For power factor = 0.5
Output Load	At nominal range
	Rn = 7.5 V / Y2 ± 1% With DC current output signal
	Rn = Y2 / 1 mA ± 1% With DC voltage output signal
Miscellaneous	Acc. to IEC / EN 60688

Additional Error

Temperature influence	± 0.2%/10°C
-----------------------	-------------

Influence of Variations

As per IEC / EN 60688 standard. Output stability	< 30 min
--	----------

Environmental

Operating temperature	-10°C...23°C...55°C(usage Group II)
Storage temperature	-30 °C to 80 °C
Relative humidity	0...95%RH(Non Condensing)
Altitude	2000m max



Measure



Control



Record



Analyze



Optimize

Technical Specifications:

Safety	
Protection Class	II (Protection Isolated, EN 61010)
Protection	Protection IP 40, housing according to EN 60 529 IP 20 ,terminal according to EN 60 529
Pollution degree	2
Installation Category	III
Insulation Voltage	1min. (EN 61010-1) 3.3kV RMS, Input versus outer surface 3.3kV RMS, Input versus all other circuits 3.3kV RMS, Auxiliary supply versus outer surface and output. 500V RMS, Output versus output versus each other versus outer surface.
Installation Data	
Mechanical Housing	Lexan 940 (polycarbonate) Flammability Class V-0 acc. To UL 94, self extinguishing, non dripping, free of halogen Rail mounting / wall mounting
Mounting position	Approx. 0.5kg
Weight	
Connection Terminal	
Connection Element	Conventional Screw type terminal with indirect wire pressure
Permissible cross section of the connection lead	≤ 4.0 mm ² single wire or 2 x 2.5 mm ² fine wire


Ambient tests

EN 60068-2-6	Vibration
Acceleration	±2 g
Frequency range	10....150...10Hz
Rate of frequency sweep	1 octave/minute
Number of cycles	10, in each of the three axes
EN 60068-2-7	Shock
Acceleration	3 x 50g
	3 shocks in each direction
IEC 61326-1: 2012, Table	Electromagnetic compatibility

Programming

Programming of transducer can be done in 2 ways

- Programming Via Optional RS485(MODBUS) Communication.
- Programming Via USB port at front of the Transducer using USB cable. The programming by this method can also be done without aux supply(power from USB).
- For Programming the transducer by any of the above two methods configuration software can be used which is available on website.

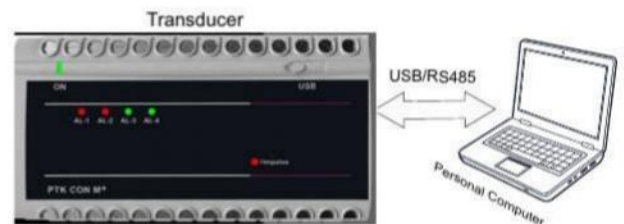

Electrical Network:

3 Phase 4 Wire Unbalanced Load		1 Phase 2 Wire	
3 Phase 3 Wire Unbalanced Load		U12 I1 3 Phase Balanced Load	
3 Phase 4 Wire Balanced Load		U13 I1 3 Phase Balanced Load	
3 Phase 3 Wire Balanced Load		U23 I1 3 Phase Balanced Load	



Measure



Control



Record




Analyze



Optimize

Terminal Details:

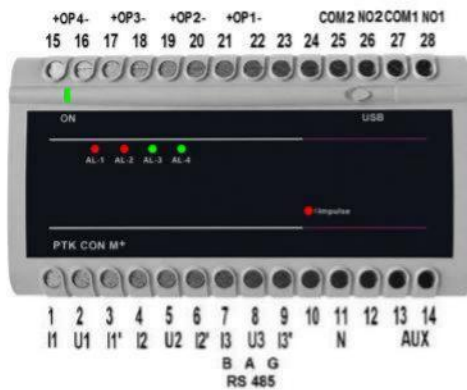

Electrical Connections

Connection	Terminal details	
Measuring Voltage Input	UL1	2
	UL2	5
	UL3	8
	N	11
Auxilliary Power supply	~, +	13
	~, -	14
Analog output - 1	+	22
	-	21
Analog output - 2	+	20
	-	19
Relay output - 1	NO COM	28
		27
RS-485	B	29
	A	30
	G	31

Connection	Terminal details	
Measuring Current Input	I1	1
	I1'	3
	I2	4
	I2'	6
	I3	7
	I3'	9
Analog output - 3	+	18
	-	17
Analog output - 4	+	16
	-	15
Relay output - 2	NO COM	26
		25

LED Indication

ON LED	Aux.supply healthy condition	Green LED continuous ON
	Transducer Powered from USB	Red LED continuous ON
AL-1	Alarm 1 trigger Condition not occur	Green LED continuous ON
	Alarm 1 trigger Condition occurred	Red LED continuous ON
AL-2	Alarm 2 trigger Condition not occur	Green LED continuous ON
	Alarm 2 trigger Condition occurred	Red LED continuous ON
AL-3	Alarm 3 trigger Condition not occur	Green LED continuous ON
	Alarm 3 trigger Condition occurred	Red LED continuous ON
AL-4	Alarm 4 trigger Condition not occur	Green LED continuous ON
	Alarm 4 trigger Condition occurred	Red LED continuous ON
Impulse LED	Energy monitoring and measurement	Red LED Blinking as per energy



Measure



Control



Record



Analyze



Optimize

Measured Parameter System wise: Table 1

✓ : Available

* : Not Available

Sr.No.	Parameters	3P4W UNBL	3P3W UNBL	1PH 2W	3P4W BAL	3P3W BAL	3P3W U12I1	3P3W U23I1	3P3W U31I1
1	System Voltage	✓	✓	✓	✓	✓	✓	✓	✓
2	Per Phase (L1,L2,L3) Voltage	✓	*	*	*	*	*	*	*
3	Phase to Phase (L12,L23,L31) Voltage	✓	✓	*	*	*	*	*	*
4	System Current	✓	✓	✓	✓	✓	✓	✓	✓
5	Per Phase (L1,L2,L3) Current	✓	*	*	*	*	*	*	*
6	System Active Power	✓	✓	✓	✓	✓	✓	✓	✓
7	System Re-active Power	✓	✓	✓	✓	✓	✓	✓	✓
8	System Apparent Power	✓	✓	✓	✓	✓	✓	✓	✓
9	Per Phase (L1,L2,L3) Active Power	✓	*	*	*	*	*	*	*
10	Per Phase (L1,L2,L3) Re-active Power	✓	*	*	*	*	*	*	*
11	Per Phase (L1,L2,L3) Apparent Power	✓	*	*	*	*	*	*	*
12	System Current Demand	✓	✓	✓	✓	✓	✓	✓	✓
13	System kVA Demand	✓	✓	✓	✓	✓	✓	✓	✓
14	System Import kW Demand	✓	✓	✓	✓	✓	✓	✓	✓
15	System Export kW Demand	✓	✓	✓	✓	✓	✓	✓	✓
16	System Ind. Var Demand	✓	✓	✓	✓	✓	✓	✓	✓
17	System Cap. Var Demand	✓	✓	✓	✓	✓	✓	✓	✓
18	System Max kVA Demand	✓	✓	✓	✓	✓	✓	✓	✓
19	System Max Imp kW Demand	✓	✓	✓	✓	✓	✓	✓	✓
20	System Max Exp kW Demand	✓	✓	✓	✓	✓	✓	✓	✓
21	System Max Ind Var Demand	✓	✓	✓	✓	✓	✓	✓	✓
22	System Max Cap Var Demand	✓	✓	✓	✓	✓	✓	✓	✓
23	System Max Current Demand	✓	✓	✓	✓	✓	✓	✓	✓
24	Per Phase (L1,L2,L3) Current Demand	✓	*	*	*	*	*	*	*
25	Per Phase (L1,L2,L3) kVA Demand	✓	*	*	*	*	*	*	*
26	Per Phase (L1,L2,L3) Import kW Demand	✓	*	*	*	*	*	*	*
27	Per Phase (L1,L2,L3) Export kW Demand	✓	*	*	*	*	*	*	*
28	Per Phase (L1,L2,L3) Inductive Var Demand	✓	*	*	*	*	*	*	*
29	Per Phase (L1,L2,L3) Capacitive Var Demand	✓	*	*	*	*	*	*	*
30	Per Phase (L1,L2,L3) Max kVA Demand	✓	*	*	*	*	*	*	*
31	Per Phase (L1,L2,L3) Max Import kW Demand	✓	*	*	*	*	*	*	*
32	Per Phase (L1,L2,L3) Max Export kW Demand	✓	*	*	*	*	*	*	*
33	Per Phase (L1,L2,L3) Max Ind Var Demand	✓	*	*	*	*	*	*	*
34	Per Phase (L1,L2,L3) Max Cap Var Demand	✓	*	*	*	*	*	*	*
35	Per Phase (L1,L2,L3) Max Current Demand	✓	*	*	*	*	*	*	*
36	System Power Factor	✓	✓	✓	✓	✓	✓	✓	✓
37	Per Phase (L1,L2,L3) Power Factor	✓	*	*	*	*	*	*	*
38	System Phase Angle	✓	✓	✓	✓	✓	✓	✓	✓
39	Per Phase (L1,L2,L3) Phase Angle	✓	*	*	*	*	*	*	*
40	Frequency	✓	✓	✓	✓	✓	✓	✓	✓
41	RPM	✓	✓	✓	✓	✓	✓	✓	✓
42	System Import Active Energy	✓	✓	✓	✓	✓	✓	✓	✓
43	System Export Active Energy	✓	✓	✓	✓	✓	✓	✓	✓
44	System Ind Reactive Energy	✓	✓	✓	✓	✓	✓	✓	✓
45	System Cap Reactive Energy	✓	✓	✓	✓	✓	✓	✓	✓
46	System Apparent Energy	✓	✓	✓	✓	✓	✓	✓	✓
47	Per Phase (L1,L2,L3) Import Active Energy	✓	*	*	*	*	*	*	*
48	Per Phase (L1,L2,L3) Export Active Energy	✓	*	*	*	*	*	*	*
49	Per Phase (L1,L2,L3) Inductive Reactive Energy	✓	*	*	*	*	*	*	*
50	Per Phase (L1,L2,L3) Capacitive Reactive Energy	✓	*	*	*	*	*	*	*



Measure



Control



Record



Analyze



Optimize

Measured Parameter System wise: Table 1

✓ : Available

✗ : Not Available

Sr.No.	Parameters	3P4W UNBL	3P3W UNBL	1PH 2W	3P4W BAL	3P3W BAL	3P3W U12I1	3P3W U23I1	3P3W U31I1
51	Per Phase (L1, L2, L3) Apparent Energy	✓	✗	✗	✗	✗	✗	✗	✗
52	Neutral Current	✓	✗	✗	✗	✗	✗	✗	✗
53	System Voltage THD	✓	✓	✓	✓	✓	✓	✓	✓
54	Per Phase (L1, L2, L3) Voltage THD	✓	✗	✗	✗	✗	✗	✗	✗
55	System Current THD	✓	✓	✓	✓	✓	✓	✓	✓
56	Per Phase (L1, L2, L3) Current THD	✓	✗	✗	✗	✗	✗	✗	✗
57	Per Phase (L1, L2, L3) Individual Voltage Harmonics	✓	✓	✗	✗	✗	✗	✗	✗
58	Per Phase (L1, L2, L3) Individual Current Harmonics	✓	✓	✗	✗	✗	✗	✗	✗
59	Run Hour	✓	✓	✓	✓	✓	✓	✓	✓
60	On Hour	✓	✓	✓	✓	✓	✓	✓	✓
61	Number of Interruptions	✓	✓	✓	✓	✓	✓	✓	✓
62	Phase Reversal Indication	✓	✗	✗	✗	✗	✗	✗	✗
63	Current Reversal Indication	✓	✗	✓	✓	✓	✓	✓	✓
64	Phase Absent Indication	✓	✗	✗	✗	✗	✗	✗	✗

Ordering Information

Ordering Information	CM44-	1	1	1	X	X	1	0000000
Product Type	PROG. TRANSDUCER / CONVERTER+							
Input Voltage	3 Phase 100-600 VLL							
Input Current	1A/5A (onsite programmable)							
Auxiliary Supply	85 - 285V AC/DC							
Output Type	4 Analog Outputs and 2 Relays				1			
	2 Analog Outputs and 2 Relays				2			
	4 Analog Outputs				4			
RS485 Communication	With RS485 communication					1		
	Without RS485 communication					2		
USB Communication	With USB communication							

Ordering Code Example : CM44-1111110000000

PTK CON M+ Prog. Transducer 3 Phase 100-600 VLL, 1A/5A, 85...285V AC/DC, 4 Analog Outputs and 2 Relays, With RS485 communication, USB communication



Measure



Control



Record



Analyze



Optimize

Specifications may change without prior notice



Measure



Control



Record



Analyze



Optimize

POWERTEK UK LIMITED

UK: 13b Southview Park, Marsack Street, Reading, Berkshire RG4 5AF, United Kingdom | +44 (0)118 370 2004 | info@powertekuk.com

US: Powertek US Inc., 7 3rd Street, Holbrook, NY 11741, USA | +1 631 824 4666 | info@powertekus.com

www.powertekuk.com